



Cap shut-off valves type CSV

COMPANY
WITH QUALITY SYSTEM
CERTIFIED BY DNV
= ISO 9001/2000 =

GMC Refrigerazione S.r.l. Via Meucci, 18 - 20060 Gessate (Mi) Italy - Tel +39 02.953853 - Fax +39 02.95383351 - www.gmc-refrigerazione.com


DIMENSIONS AND TECHNICAL CHARACTERISTICS OF CUP SHUT-OFF VALVES

Type	Connections			Kv [m ³ /h]	TS [°C]		PS [bar]	Dimensions [mm]						Category 97/23/CE PED
	SAE Flare	ODS			min	max		H ₁	H ₂	L ₁	d	i	CH	
		[in.]	[mm]											
CSV2	1/4"	-	-	0,4	- 60	110	45	86	68	68	4,5	38	27	Art. 3.3
CSV3	3/8"	-	-	1,0						74				
CSV4	1/2"	-	-	1,5						78				
CSV5	5/8"	-	-	1,7						57				
CSV2S	-	1/4"	-	0,4						61				
CSV3S	-	3/8"	-	1,0						70				
CSVM10S	-	-	10	1,5						71				
CSVM12S	-	-	12											
CSV4S	-	1/2"	-											
CSV5S	-	5/8"	-	1,7										


APPLICATIONS: They are designed for installation on commercial refrigerating systems and on civil and industrial conditioning plants, which use fluids proper to the Group II, as defined in Article 9, Section 2.2 of Directive 97/23/EC, therefore not toxic, not inflammable and not explosive fluids; to this macro Group II belongs also the refrigerant fluids listed and classified L1 in Annex E of standard EN 378-1:2003.

CONSTRUCTION: The body is manufactured in hot-forged brass UNI EN 12420 - CW617N and the spindle is made in steel with zinc galvanized surfaces. In the cap shut-off valves are employed, in order to prevent leakages towards the outside, gaskets composed of aramide fibers (this material is resistant to the high temperatures and it has approvals of DIN-DVGW acc. to DIN 3535, part 6 FA) and gaskets composed of cloroprene rubber.

INSTALLATION: Read carefully the instruction of installation inserted in the package. For CSV_S types, dismantle the valve before brazing the body to the system: unscrew the spindle assembly acting on the hexagonal nut.

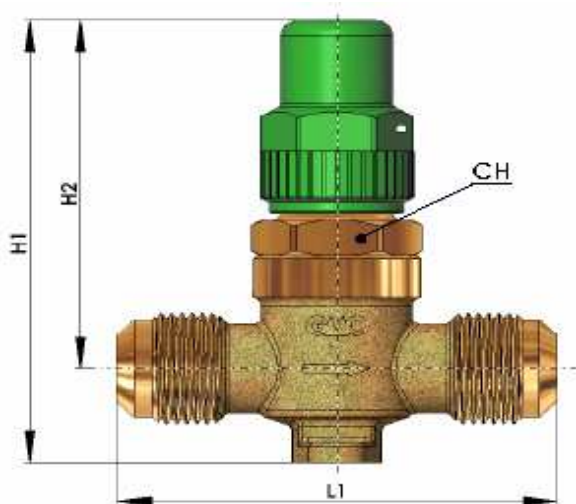

Type CSV

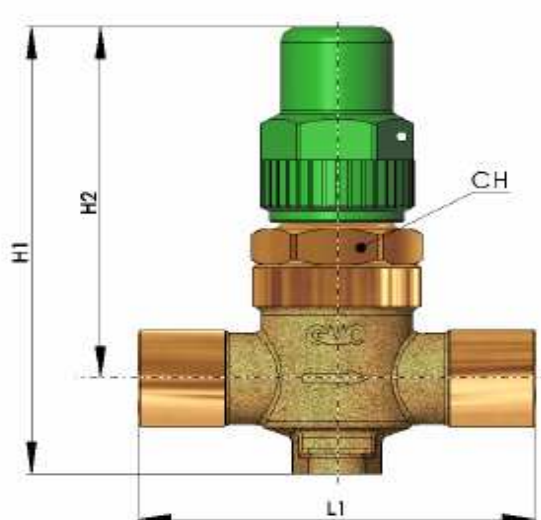

Type CSV...S

